

Explosives Regulations 2014

Guidance on Regulations – Fireworks in retail premises

© Crown copyright 2015

First published 2015

You may re-use this information (excluding logos) free of charge in any format or medium, under the terms of the Open Government Licence. To view the licence, visit www.nationalarchives.gov.uk/doc/open-government-licence/, write to the Information Policy Team, The National Archives, Kew, London TW9 4DU, or email psi@nationalarchives.gsi.gov.uk.

Some images and illustrations may not be owned by the Crown so cannot be reproduced without permission of the copyright owner. Enquiries should be sent to copyright@hse.gsi.gov.uk.

This guidance has been developed by a sector working group established under the Explosives Legislative Review www.hse.gov.uk/explosives/explosives-legislative-review.htm. It includes content previously found on HSE's website and in the Approved Code of Practice to the Manufacture and Storage of Explosives Regulations 2005 (L139) which was withdrawn on 1 October 2014.

This guidance is issued by the Health and Safety Executive. Following the guidance is not compulsory, unless specifically stated, and you are free to take other action. But if you do follow the guidance you will normally be doing enough to comply with the law. Health and safety inspectors seek to secure compliance with the law and may refer to this guidance.

Acknowledgements

HSE would like to thank working groups within the explosives industry for their help in producing this guidance.

Contents

Introduction	5
Who is this publication for?	5
What is this publication about?	5
Other guidance that applies to the storing and selling of fireworks in retail premises	5
Other legislation that applies to fireworks in retail premises	5
Application and scope of the Regulations	6
<i>Explosives for work, personal and recreational use</i>	<i>6</i>
<i>Transport</i>	<i>6</i>
<i>Application offshore</i>	<i>6</i>
<i>Explosives in use</i>	<i>6</i>
<i>Hazard type</i>	<i>6</i>
Terminology	8
Safety requirements	9
General principles of safety in explosives operations	9
Regulatory framework	9
Fire and explosion measures (Regulation 26)	10
Safety measures	10
<i>Identify safety measures</i>	<i>10</i>
<i>Risk assessment</i>	<i>11</i>
Management arrangements	11
Cross-cutting safety measures	12
<i>Competence</i>	<i>12</i>
<i>Safe systems of work and working practices</i>	<i>13</i>
<i>Housekeeping</i>	<i>14</i>
<i>Barriers</i>	<i>14</i>
<i>Stock management</i>	<i>15</i>
<i>Segregating explosives presenting different likelihoods of initiation</i>	<i>15</i>
<i>Segregating explosives operations from other activities</i>	<i>16</i>
<i>Safely transporting explosives on site</i>	<i>17</i>
Preventing fires and explosions	17
<i>General precautions</i>	<i>18</i>
<i>Protecting explosives from sources of ignition</i>	<i>18</i>
<i>Maintenance systems</i>	<i>21</i>
Measures to limit the extent of a fire or explosion	22
Protecting people from the effects of fire or explosion	22
<i>Limiting the numbers of people in explosives areas</i>	<i>23</i>
<i>Engineering controls</i>	<i>23</i>
<i>Provision of personal protective equipment</i>	<i>24</i>
<i>Emergency procedures</i>	<i>24</i>

Separation distances	26
Application.....	26
Discarding, disposal and decontamination	27
Discarding and disposal of explosives	27
Vacating an explosives site.....	27
Prohibitions concerning manufacture, storage and importation of certain explosives.....	28
Prohibitions concerning the acquisition and supply of fireworks.....	29
Security and preventing unauthorised access to fireworks.....	30
Appendix 1 Identifying hazard type and net mass of explosives from labelling and documentation	31
Identifying hazard division and indicative hazard type from transport carton labels.....	31
Identifying net mass from transport carton labelling	31
Identifying hazard division, net mass and classification status from transport documentation	32
Appendix 2 Further information on the suitability of cages, cabinets and cupboards for the storage of fireworks	34
Introduction.....	34
The tests.....	34
Guidance	35
<i>50 mm mesh cages</i>	<i>35</i>
<i>25 mm mesh cages</i>	<i>35</i>
<i>Points applying to all mesh cages</i>	<i>36</i>
Relevant assumptions and type testing	36
Appendix 3 Further information on the display of fireworks in a sales area	37
Introduction.....	37
Preventing accidental ignition	37
Controlling the quantity in the sales area.....	38
Slowing the spread of fire in the sales area.....	39
Protecting people in the sales area in the event of a fire.....	39
Glossary.....	41
References and further reading	44
References.....	44
Further reading.....	44
<i>Hazard identification and evaluation and the assessment of risk</i>	<i>44</i>
<i>Managing safety</i>	<i>44</i>
<i>Topic-based guidance</i>	<i>45</i>
<i>Pyrotechnic Articles (Safety) Regulations 2010</i>	<i>46</i>
<i>Shipping dangerous goods including fireworks</i>	<i>46</i>
Further information.....	47

Introduction

Who is this publication for?

1 This publication is for dutyholders who store Hazard Type 3 (HT3) and Hazard Type 4 (HT4) fireworks in retail premises and similar environments.

2 It also contains material relevant to enforcing authorities such as local authority trading standards officers, the police, fire and rescue services and other emergency services. This publication may also be of interest to other government or regulatory agencies and waste disposal operators.

What is this publication about?

3 This publication provides guidance on the safe and secure storage of HT3 and HT4 fireworks in retail premises. It explains why some of the day-to-day precautions are necessary, and supplements guidance available elsewhere.

4 It also provides guidance on some wider areas which are relevant to the Explosives Regulations (ER2014). These wider areas are included as they help support compliance with the safety provisions.

5 Following this guidance will enable compliance with the safety and security provisions of ER2014 (SI 2014/1638) where they relate to the storage of HT3 and HT4 fireworks in retail premises.

Throughout this guidance, you will see statements in boxes. These statements identify successful outcomes of the application of appropriate safety and security measures to explosives operations. Dutyholders can use the statements to challenge themselves on the effectiveness of the safety and security precautions that they have implemented.

Other guidance that applies to the storing and selling of fireworks in retail premises

6 HSE has published a summary of the straightforward steps that people storing and selling fireworks in retail premises should follow on a day-to-day basis¹.

7 HSE has also published detailed guidance on the safety provisions (L150)² and security provisions (L151)³ of ER2014. This guidance provides the background to this document and will be useful to those who require a deeper understanding of the precautions which are required to store and sell fireworks safely and securely.

8 L150 and L151 are referred to throughout this guidance. In each case, we have quoted the relevant section to make it easier for you to find the information you need.

Other legislation that applies to fireworks in retail premises

9 There are other general health and safety regulations which apply to fireworks in retail premises. This publication gives additional guidance where there are particular issues which need to be considered; for example, in selecting work or personal protective equipment, or in vacating an explosives site.

10 The Pyrotechnic Articles (Safety) Regulations 2010 (SI 2010/1554) apply to the retail of fireworks. These regulations transpose European Directive 2007/23 on the placing on the market of pyrotechnic articles into UK law. The Regulations deal with the harmonisation of standards and the safety of pyrotechnic articles (including fireworks) placed on the market. They also define:

- those products which are available to the general public and the specific age restrictions on sale; and
- those articles which are only for supply to specialists.

11 The Fireworks Regulations 2004 (SI 2004/1836) apply to anyone selling fireworks or exposing them for sale. If you sell or offer for sale adult fireworks outside certain times of the year, you will need a licence granted under the Fireworks Regulations 2004. This licence is in addition to any licence granted under ER2014 that allows you to store fireworks.

12 Fire safety legislation also applies to premises used for the retail of fireworks.

Application and scope of the Regulations

13 Regulations 2 and 3 of ER2014 identify how the Regulations apply to explosives operations. This section provides supporting guidance on how the Regulations apply to the safety and security of fireworks in retail premises.

Explosives for work, personal and recreational use

14 ER2014 apply to fireworks whether they are for work or non-work purposes. They therefore apply to anyone storing fireworks for personal recreational use, or to voluntary clubs or societies storing explosives (examples include storage for firework displays, bonfire processions or re-enactment events).

Transport

15 ER2014 *do apply* to the transport of fireworks on site. This includes movement on public roads between different buildings on the same site.

16 ER2014 *do not* apply to fireworks which are being transported by road, rail, air or water provided that the fireworks are not kept in one place for longer than 24 hours.

17 Explosives which are being transported will be treated as being in storage when they are kept, or are to be kept, at one place for more than 24 hours.

18 Dutyholders who keep explosives which are being transported as part of the supply chain should ensure that any explosives whose onward journey cannot take place are stored safely and lawfully.

19 As a general rule, where explosives are on a stationary vehicle which has arrived at its destination and does not have an onward journey, and have not been unloaded within a reasonable period of time, the explosives should be regarded as being in storage.

Application offshore

20 The retail of fireworks is extremely unlikely to take place offshore. However, detailed guidance can be found in the 'application offshore' section of L150.

Explosives in use

21 The safety provisions of ER2014 do not generally apply to explosives which are in use.

Hazard type

The role of hazard type

22 Hazard type (HT) is central to both the safety provisions and the licensing elements of the Regulations.

23 Hazard type defines and describes the nature of the hazard arising from a firework in storage conditions.

Definition of 'hazard type' and its relationship to hazard division

24 Definitions of the hazard types are given in regulation 2 of ER2014:

- *Hazard Type 1: '...an explosive which, as a result of, or as a result of any effect of, the conditions of its storage or process of manufacture, has a mass explosion hazard' (a mass explosion can be one in which the entire body of explosives explodes as one; where a substantial proportion of the explosives present could explode in such a way that the practical hazard should be assessed by assuming simultaneous explosion of all of the explosives present; or one which is associated with a serious blast hazard);*
- *Hazard Type 2: '...an explosive which, as a result of, or as a result of any effect of, the conditions of its storage or process of manufacture, has a serious projectile hazard but does not have a mass explosion hazard' (where a fragment hazard arises solely as a consequence of the store where the explosives are being kept breaking up, the explosives would normally be treated as Hazard Type 1);*
- *Hazard Type 3: '...an explosive which, as a result of, or as a result of any effect of, the conditions of its storage or process of manufacture, has a fire hazard and either a minor blast hazard or a minor projectile hazard, or both, but does not have a mass explosion hazard' (ie those explosives which give rise to considerable radiant heat or which burn to produce a minor blast or projection hazard);*
- *Hazard Type 4: '...an explosive which, as a result of, or as a result of any effect of, the conditions of its storage or process of manufacture, has a fire hazard or slight explosion hazard, or both, with only local effect' (ie those explosives which present only a relatively low explosive hazard in the event of ignition or initiation, where no significant blast or projection of fragments of appreciable size or range is expected).*

25 Hazard division is the classification assigned (along with a four-digit UN Number) by a competent authority for an explosive as packaged for transport according to the requirements of the UN scheme. Hazard types share similar criteria for describing behaviours (blast, fragmentation etc) as hazard divisions but represent the hazards posed in manufacture and storage rather than when an explosive has been packaged for transport.

Determination of hazard type

26 For those fireworks being kept as packaged for carriage, and which have been classified, there will generally be a direct correlation between the UN hazard division (HD) assigned them on classification for transport, and the hazard type (HT) they should be allocated for storage, ie:

- UN HD 1.1 (UN 0333) = HT1
- UN HD 1.2 (UN 0334) = HT2
- UN HD 1.3 (UN 0335) = HT3
- UN HD 1.4 (UN 0336 & UN 0337) = HT4

27 Fireworks sold in retail premises will normally have been classified for transport as UN HD 1.4. Some fireworks sold on retail premises will have been classified as UN HD 1.3, and it is possible that some specialist retailers may supply fireworks that have been classified as UN HD 1.1 and UN HD 1.2.

28 Some fireworks that would normally attract a 1.3 classification are packaged in such a way that they can be treated as HD 1.4 (and HT4) in their transport packaging (aka mitigatory packaging). Particular care needs to be taken with these fireworks to ensure that:

- they are not removed from their transport packaging in an explosives store but in an appropriate place outside the store;
- they are handled appropriately when they are removed from their transport packaging; and
- their transport packaging is properly closed when items are removed, and before the packaging is returned to the explosives store to ensure that the fireworks it still contains can continue to be treated as HT4.

29 Where the above conditions are met and the fireworks are removed from their packaging, provided to the customer and removed from the premises without delay, the storage activity can continue to be treated as HT4.

30 Where fireworks would present a higher hazard (HT1 or HT2) when removed from mitigatory packaging, either:

- a detailed assessment of the implications for the HT of the storage hazards associated with the removal of the fireworks should be undertaken, and appropriate controls to mitigate those hazards implemented; or
- the fireworks should be supplied to the customer in the full transport packaging.

31 More information on how to identify and safely store fireworks which are transported in mitigatory packaging can be obtained from suppliers. Your supplier should also provide you with information on how to properly close any mitigatory packaging once it has been opened.

32 Appendix 1 provides further information on how to identify the hazard type of fireworks from labels and information on transport cartons and from transport documentation.

Terminology

33 Further information on various terms used in the Regulations and in this document can be found in the Glossary.

Safety requirements

Explosives operations are subject to robust controls to maintain safety standards.

General principles of safety in explosives operations

34 High standards of safety need to be in place before explosives operations (including those involving fireworks) start, and they should remain in place – and be effective – for as long as the explosives operations continue. It is generally difficult or impossible to regain control of an event involving explosives once control has been lost. The effects of an explosive event involving fireworks can often be catastrophic and can impact those beyond the immediate activity, eg members of the public and the emergency services. The safety provisions of ER2014 provide the regulatory framework for identifying and implementing these standards of safety, and are based on generally recognised principles of safe operation in the sector.

35 Further information on the ten general principles underpinning the safety provisions of ER2014 can be found in L150 under 'General principles of safety in explosives operations'.

Regulatory framework

36 The safety provisions in ER2014 are contained within five Regulations:

- **Regulation 26** requires anyone manufacturing or storing explosives to take appropriate measures:
 - to prevent fire or explosion;
 - to limit the extent of fire or explosion, including measures to prevent the spreading of fires and the communication of explosions from one location to another; and
 - to protect people from the effects of fire or explosion.
- **Regulation 27** requires people storing explosives to maintain separation distances, identifies the circumstances in which separation distances do not need to be applied, and identifies how separation distances are applied to certain sites that are granted a licence by HSE or the Office for Nuclear Regulation (ONR).
- **Regulation 28** requires anyone discarding or disposing of explosives, or who is decontaminating explosive-contaminated items, to ensure, so far as reasonably practicable, that they are undertaking those activities safely.
- **Regulation 29** prohibits the manufacture and storage and import of pyrotechnics containing sulphur and/or phosphorus mixed with chlorates without the approval of HSE.
- **Regulation 13** relates mainly to the grant of licences but also includes safety provisions. It allows licensing authorities to reinforce the requirements of regulation 26 as they relate to the sale of fireworks at a site which they have licensed for the storage of explosives.

Fire and explosion measures (Regulation 26)

During manufacture and storage, appropriate measures are taken to:

- prevent an unplanned fire or explosion;
- limit the extent of fires or explosions;
- prevent fires spreading;
- stop explosions communicating from one place to another; and
- protect people from the effects of a fire or explosion.

Safety measures

37 The approaches taken for the safe display, storage and handling of fireworks in retail and other similar premises (such as cash-and-carry stores) are the same as those taken to ensure the safety of other types of explosive. Those storing fireworks should identify the safety measures to be taken by carrying out a risk assessment, and take the appropriate measures to control the risks identified.

38 When storing fireworks, the primary initiating events that need to be considered are a fire elsewhere on the premises or the accidental initiation of the fireworks by other means. The principal hazards that need to be considered are the spread of fire, the propagation of any explosives event, and the potential for people to be struck by fireworks effects.

39 The safety measures taken should ensure that:

- the likelihood of an event involving fireworks or explosives is minimised;
- an event involving fireworks or other explosives which are being worked on will not communicate to fireworks or other explosives in storage;
- people present on site will be able to evacuate before the fireworks (or any other dangerous substances) become involved in any outbreak of fire; and
- people both on and off the site are adequately protected from both fire and the potential consequence of any event involving the fireworks or explosives.

Identify safety measures

Safety measures to:

- prevent unplanned fires and explosion;
- prevent the spread of fire and the communication of an explosion; and
- protect people from the effects of a fire and explosion

are identified using a structured approach.

40 In deciding if the prevention and mitigation control measures in use on a retail premises are appropriate, the primary consideration will be to ensure that employees and other people are protected from harm by fire.

41 The principal objectives of the appropriate measures will be to ensure that sources of ignition are controlled and that people will be able to evacuate before the fireworks (or any other dangerous substances) become involved in any outbreak of fire.

Risk assessment

42 Employers will generally identify and implement appropriate measures as an outcome of a risk assessment or as part of the implementation of a safety management system. HSE has published a 'retailers risk assessment checklist'⁴ which can be used by people who sell fireworks, to help them carry out a risk assessment and plan what actions they need to take to protect the safety of staff and customers.

43 Where the site or the activities undertaken are complex, it may be necessary to conduct a more detailed hazard identification and evaluation in support of the risk assessment. Further information on hazard identification and evaluation and the assessment of explosives risks can be found in Appendix 1 of L150.

44 Employers and the self-employed who comply with the risk assessment requirements of:

- the Management of Health and Safety at Work Regulations 1999 (SI 1999/3242) (the Management Regulations);
- the Dangerous Substances and Explosive Atmospheres Regulations 2002 (SI 2002/2776) (DSEAR); and
- fire safety legislation

will have taken the steps necessary to identify the appropriate measures they are required to take under regulation 26(1) of ER2014.

45 Regulation 3 of the Management Regulations requires all employers and self-employed people to assess the risks to workers and any other people who may be affected by their work or business. This is to enable them to identify the sensible and proportionate measures they need to take to control the risks.

46 Regulation 5 of DSEAR requires a risk assessment to be carried out to identify whether dangerous substances are present at the site and the risks they present. DSEAR applies to all hazards arising from both the manufacture and storage of explosives and from the other dangerous substances on site. This includes, for example, substances not in use, or those in storage awaiting use.

47 Fire safety legislation requires responsible persons to make a suitable and sufficient assessment of the risks to which relevant people are exposed. This is to identify the general fire precautions that need to be taken to comply with the requirements and prohibitions imposed by fire safety legislation.

Management arrangements

Appropriate safety measures are in place. Roles and responsibilities for implementing and maintaining them are specified and understood.

48 Arrangements should be in place to manage explosives operations. These arrangements should address the responsibilities for:

- identifying;
- implementing; and
- maintaining

the safety measures.

49 Employers and the self-employed will generally identify and implement management arrangements as a consequence of their duties under regulation 5 of the Management Regulations.

50 Employers will also have duties as a responsible person under fire safety legislation.

51 Further information can be found in Appendix 2 of L150.

Cross-cutting safety measures

Cross-cutting safety measures (ie measures that address more than one duty) are implemented to ensure the safe manufacture and storage of explosives.

52 Some safety measures are particularly important because they reduce the risk of a fire or explosion being initiated and limit the consequences in the event of an initiation. These safety measures are:

- appropriate training and competence;
- safe systems of work and working practices;
- high standards of housekeeping;
- providing and maintaining appropriate barriers;
- effective stock management;
- segregating explosives presenting different likelihoods of initiation (or different hazard types);
- segregating explosives operations from other activities; and
- safely transporting explosives on site.

Competence

People manufacturing or storing explosives are competent to carry out activities under normal conditions. They understand the hazards and risks which may arise and the actions to take in abnormal or emergency situations.

53 Competent people understand how a fire and explosion can occur and know what to do to prevent it. They understand how it can be stopped from spreading or communicating to other explosives, and know what to do to protect people including themselves.

54 Dutyholders should have systems in place to assess and identify training and competency needs. They should also follow up where training needs are identified or competency needs to be developed. The extent and formality of these systems depends on factors such as the outcomes of the risk assessment, the complexity of the explosives operation, the size of the organisation, and the rate of turnover of the people involved in the operation. Competence should be reviewed at periodic intervals and when there have been significant changes to:

- people;
- procedures;
- equipment; and

- materials

or when the regulatory framework or recognised industry practice has changed.

55 Training provided to workers should include instructions on:

- storing fireworks well away from flammable liquids and materials that can easily catch fire and burn;
- controlling the quantities being stored, handled, processed or displayed in areas where people work or gather;
- prohibiting smoking anywhere near the fireworks;
- ensuring that sources of heat, such as space heaters, are kept well away from fireworks;
- keeping fireworks in closed transport packaging whenever it would be practicable to do so;
- storing fireworks away from hazardous substances;
- protecting fireworks from damp;
- ensuring that other chemicals do not contaminate fireworks;
- how to avoid accidental damage to packaged fireworks; and
- what to do in an emergency.

Safe systems of work and working practices

Explosives operations and activities involving fireworks are carried out to agreed procedures.

56 Developing the safety measures for the safe storage and sale of fireworks on retail premises will normally include consideration of:

- the activity and where it is to be carried out;
- the sequence of the tasks needed to complete the activity and how they will be done;
- the outcomes of the hazard identification and analysis;
- the skills and competencies required to deal with the hazards;
- the precautions necessary to prevent a fire and explosion; to stop a fire spreading and an explosion communicating; and to protect people from the effects of a fire or explosion;
- recognised and generally accepted safety procedures covering known hazards;
- how the firework-related activities will be segregated from other activities, and any controls necessary to maintain that segregation;
- the tools and equipment (including personal protective equipment) to be used; and
- how to minimise both fireworks waste and other waste that could act as a source of ignition for the fireworks, and how that waste will be managed prior to disposal.

57 Procedures would be expected to include the following activities:

- receipt and unloading of deliveries;
- storage of fireworks;
- removing fireworks from transit packaging;
- movement of fireworks on site;
- providing fireworks to customers;
- managing returns from customers and to suppliers; and
- management and disposal of damaged stock.

Housekeeping

High standards of housekeeping are maintained to:

- **provide control over sources of initiation;**
- **prevent fires and explosions;**
- **reduce the likelihood of a fire spreading or an explosion communicating; and**
- **reduce the risks of people becoming trapped or harmed if a fire or explosion occurs.**

58 Areas where fireworks are being stored should be kept clean and tidy. Only those materials necessary for the storage operations should be kept in the storage area, and particular attention should be paid to preventing the build-up of flammable fines (small particles of flammable materials).

59 Damp fireworks can be dangerous, especially to users. Damp fireworks are also more likely to leak explosive compositions that increase the likelihood of a fire or that can help a fire to spread. Therefore, appropriate measures should be taken to keep fireworks dry. Cabinets and display cases should be dry before use to avoid the fireworks becoming damp. They should be thoroughly cleaned after use to ensure no loose composition is left behind.

60 In order to avoid the spillage of explosives, fireworks should only be transferred from one transport package to another when necessary.

Barriers

Barriers are used, where appropriate, to prevent or limit the spread of fires or the communication of an explosion, and to protect people.

61 Barriers are physical structures that will prevent or delay the spread of fire, and that will intercept fragments and debris caused by an explosive event in a building or store. Doors can often act as an effective barrier to the communication of a minor event.

62 Areas where fireworks are stored should be physically separated from the sales area by an appropriate barrier. The purpose of the barrier is to protect people in the sales area from projected effects while they are moving to a place of reasonable safety.

63 Barriers could include a brick or breeze block wall or a suitably robust stud partition (eg half-hour fire-resistant) or sheet steel structure. Any doors in the barrier should be self-closing and capable of providing effective protection to people in the sales area.

64 Standards for constructing half-hour fire-resistant structures can be found in Appendix B of the Department for Communities and Local Government guide *Fire safety risk assessment: Offices and shops*⁵.

Stock management

Dutyholders know the type and quantity of all explosives present on site and their locations.

65 Dutyholders should have a suitable stock management system to ensure that appropriate information is available in an emergency. Dutyholders should be able to tell the fire and rescue service:

- the types and quantities of fireworks present on the site which are involved in the fire;
- whether any other fireworks are present elsewhere on site; and
- the hazards that the fireworks present.

66 The fire and rescue service should also be told whether any other dangerous substances are present on the site, their quantities and where they are.

67 A suitable stock management system will also enable dutyholders to ensure that any licence limits (or relevant exceptions) are not breached.

68 Stocks should be managed to identify any potential deterioration in packaging and to avoid the need to repack fireworks. Some of the empty transport packages should be retained and safely stored so that any unsold fireworks can be repacked in their original, authorised, UN transport packaging for either continued storage on site, return to the supplier or transport elsewhere. There are legal requirements on the packaging of fireworks for transport, and advice from the supplier or other competent person (such as a dangerous goods safety adviser) should be sought on how unsold articles should be repackaged for transport.

69 Any empty transport cartons should be opened out and stored flattened so that they cannot be mistaken for full cartons in an emergency.

Segregating explosives presenting different likelihoods of initiation

Explosives which have significantly different likelihoods of initiation are segregated from one another.

70 Fireworks should only be removed from their transport packaging in an appropriate place. Normally, this will be outside the store in a place where an event involving the fireworks being handled will not communicate directly with the fireworks in the store.

71 Damaged fireworks (other than those where the damage is simply cosmetic) generally present an enhanced likelihood of initiation and should be stored in a designated place segregated from fireworks which are not damaged. Where a damaged firework has been assessed as being safe to store, this segregation can be achieved by storing them within an appropriately labelled, authorised UN transport carton kept in a separate suitable storage cabinet.

72 Further guidance on managing damaged fireworks in retail premises should be available from the supplier of the firework.

Segregating explosives operations from other activities

Explosives operations are segregated from activities that do not include explosives.

73 Where it is not possible to reserve a storeroom exclusively for the storage of fireworks, the bulk of the fireworks (other than those presenting a negligible explosive hazard such as party poppers and Christmas crackers) should either be stored away from the shop premises or be kept:

- away from the sales area in their closed transport packaging in a fire-resistant cabinet or container;
- away from the sales area in their closed transport packaging within a suitable cage; or
- in a suitable display case.

74 With some larger fireworks, it may be necessary to remove shelves etc from cabinets or containers before transport packaging will fit into the available space. Suppliers should be able to provide advice on:

- the minimum dimensions of any cabinet required for the storage of larger fireworks; and
- how the carton should be orientated so that the fireworks contained within it are not damaged during storage.

75 Where it would not be reasonably practicable to obtain a cabinet or container of dimensions suitable for the packaged fireworks, or to modify an existing cabinet or container so that it became suitable, the fireworks can be stored without their transport packaging, provided that:

- the packaging is not mitigatory packaging;
- the fireworks are neatly stacked in accordance with the supplier's advice;
- any additional guidance provided by the supplier is followed; and
- storage arrangements are subject to regular inspection by a competent person to ensure that the fireworks:
 - remain neatly stacked;
 - have not become damaged as a consequence of the storage arrangements; and
 - have not deteriorated in a way that might affect their performance during use.

76 Further information on the fire resistance of cabinets and suitability of cages can be found in Appendix 2.

77 Fireworks should not be stored anywhere where, in the event of a fire, the fire could quickly spread from or to any other flammable materials (for example, white spirit, barbecue-lighting fluid, paint thinners or other flammable liquids, matches, firelighters) or materials that can easily catch fire (for example, bulk quantities of paper, cardboard, surplus wooden pallets, tights, stockings or other clothing).

78 Fireworks should not be stored with products that might create an additional explosion hazard, including:

- products such as fertilisers containing oxidising agents;

- products containing peroxides such as certain fibreglass hardeners; and
- aerosols and bottled gas canisters.

79 Other than in those circumstances described in paragraph 76, fireworks should only be removed from their transit packaging immediately before they are:

- placed into a display cabinet; or
- given to a customer.

Safely transporting explosives on site

Particular care is taken when transporting explosives on site, and only appropriate methods are used.

80 All movements of fireworks around the site should be properly supervised in order to ensure that:

- the fireworks are never left unattended;
- fireworks are not left, however briefly, in places where they could be inadvertently mixed up with other goods – especially flammable products; and
- boxes containing fireworks are not inadvertently handled by staff (or members of the public) unaware of their contents.

81 When fireworks which are being kept in an explosives store have been sold to a customer, they should, in general, be taken direct from the explosives store to the customer on the shop floor.

82 When fireworks are to be placed in a display cabinet, they should be taken direct from the explosives store to the shop floor.

83 Where it is necessary for logistical reasons to keep fireworks temporarily in a place other than a designated explosives store, they should be kept in a holding area specified for that purpose and:

- the quantity in movement at any one time should be kept to the minimum necessary;
- the stock replenishment should be timed to avoid the fireworks being in movement for an unnecessarily long period of time;
- the holding area should be away from other goods; and
- the fireworks should not be left unattended.

84 Fireworks in holding areas should be kept in metal-caged trolleys or in other containers that will limit the throw of fragments or projected effects should an explosive event take place.

Preventing fires and explosions

(Regulation 26(1)(a))

Safety measures are in place to prevent the accidental initiation of explosives.

85 Keep sources of ignition away from the fireworks or other flammable materials on site. The presence of fireworks (and explosive vapours and dusts) should be controlled, especially in areas of activity, for example, places where work is done or where people or other traffic move around regularly.

86 The following sections give guidance on how the main sources of ignition can be controlled and the general principles that can be followed to prevent fire and explosion.

General precautions

Explosives operations only occur in an appropriate place, using appropriate tools and equipment and following an appropriate process.

87 Activities involving fireworks should only be undertaken in a suitable place and within the scope of any licence or other permission. The suitability of the location will depend on the quantity and type of fireworks and on the planned activity.

88 The precautions are covered in detail in paragraphs 93-114. In summary, they include ensuring that any place of manufacture, processing facility, store, storage area, container or cupboard is:

- suitably weatherproof;
- designed to ensure that explosives do not come into contact with substances with which they are incompatible;
- protected by a lightning conductor, where appropriate;
- not used for other activities at the same time that explosives are being manufactured, processed or kept, eg a store should only be used to keep explosives and the tools or implements necessary for the safe keeping of those explosives; and
- kept clean, with steps taken to prevent grit entering unpackaged explosives.

89 ISO containers (or similar metal storage units) used for firework storage should be kept in an area away from public access. Measures should be taken to prevent smoking and the build-up of flammable materials in the immediate area of the container.

90 It is not normally practicable to ensure safety when fireworks are stored in a public place without employing extensive precautions. Where a container is located in a public place such as a car park, it is essential to take effective measures to prevent vehicular impacts, arson or other malicious attacks.

91 The ISO or similar container should either be under constant supervision, or other physical measures such as the erection of a suitable fence, to prevent unauthorised access to the area around the container. Cars and other vehicles should not be permitted to park within 3m of the container.

92 Where a container used for the storage of fireworks is kept in a goods delivery yard, it is important to put it in a suitable place to reduce the risk of it being hit by vehicles. Access to the area surrounding the container should be controlled.

Protecting explosives from sources of ignition

Fireworks are protected from those sources of ignition that could cause them to initiate, and are kept in a suitable closed container or in suitable packaging, whenever it would be reasonably practicable to do so.

93 Where fireworks are kept in a store used exclusively for this purpose, the transport packaging alone may be considered to be a container providing sufficient protection, providing that the safety measures set out in paragraphs 94-117 are taken.

94 The transport packages should not be left opened in the storage area. The packages should normally only be opened when access to the fireworks is needed (eg if the contents are to be transferred to a display cabinet).

95 After opening, it is important to close the packaging securely if fireworks remain in the package (for example, by taping box flaps down, interleaving the flaps, or securing them by placing a suitably-sized wooden sheet over the flaps).

Naked lights and flames

Robust systems are in place to prevent the introduction of naked lights and flames into explosives areas.

96 Generally, any equipment or article that could introduce a naked light or flame should not be brought into an explosives area. This means that matches, lighters and smokers' materials should be forbidden from explosives areas.

Heat and temperature

Potential sources of heat energy and high temperature are identified and kept to the minimum necessary for the safe operation of an explosives area.

97 Ensure that fireworks do not come into unintentional contact with hot surfaces, or are exposed to direct sunlight and other strong sources of illumination.

98 Heating devices with exposed elements, such as electric fan heaters and gas-powered or other similar convection heaters, should not be used in explosives areas. Oil or water-filled electrically powered portable radiators can be used where fixed heating systems that use, for example, hot water or steam are not available.

99 Site (or guard) radiators and pipes to prevent physical contact with containers holding fireworks. The maximum temperature of all radiators and heating pipes should be limited either by specification or by the use of suitable thermal cut-outs. It is also recommended that heating units with tamper-proof controls and an indication to show when they are energised are fitted. Radiators sited in dusty areas should be cleaned regularly.

Electrical, electrostatic and electromagnetic energy

Sources of electrical energy are identified and kept to the minimum necessary for the safe operation of an explosives area.

100 Electrical equipment and installations within any explosives area should be confined to that equipment which is essential to the operation of the facility. Where it is necessary to install electrical equipment, it should conform to the relevant standards and must be designed and constructed to prevent it becoming a source of ignition.

101 Suitable lightning protection should be installed in fireworks stores, except where the store:

- is temporary (for example, for use during legally specified sales periods or for no more than a few weeks on a seasonal basis) and holding Hazard Type 4 fireworks;
- is used to keep less than 75 kg of HT4 fireworks;
- is used to keep less than 25 kg of HT3 fireworks;
- is made by excavation and is thereby inherently protected from lightning; or

- is exempted under the terms of a licence issued by HSE or ONR.

102 Lightning protection should be based on the requirements set out in an appropriate relevant standard.

103 Steel-framed structures with metallic cladding may be regarded as self-protecting, provided the requirements of paragraph 32 of Appendix 3 to L150 are met.

104 Steel ISO or similar containers used for the storage of explosives can be regarded as self-protecting, provided that:

- the walls are lined with wood (or other appropriate lining) or the explosives are kept at least 150 mm away from the container's walls;
- the panels and doors are electrically bonded with straps of a cross-section of at least 50 mm²;
- two earthing points connected to earth rods are provided at opposite corners; and
- resistance from the top of the container to earth is less than 10 ohms.

105 Further guidance on protecting explosives from electrical, electrostatic and electromagnetic energy can be found in Appendix 3 of L150.

Mechanical sparks

Potential sources of mechanical sparks, including those that could arise from equipment failure, are identified and kept to the minimum necessary for the safe operation of an explosives area.

106 Where it would be reasonably practicable to do so, the metal and other surfaces in explosives areas that have the potential to generate mechanical sparks should be replaced with, or covered by, a durable non-metallic material such as paint.

107 Ferrous and other hand tools capable of producing mechanical sparks (eg staple guns) should only be used where they do not present a significant risk of initiation and precautions have been taken to avoid metal-to-metal contact.

108 Where it is necessary to use tools and equipment such as angle grinders or other power tools in an explosives area, for example during a maintenance activity, any explosives should be removed from the area or precautions should be taken to completely segregate the explosives or any other flammable materials from any sparks that the tools and equipment may produce. This is to prevent the equipment acting as a source of ignition.

Impact and friction

Potential sources of impact and friction are identified and kept to the minimum necessary for the safe operation of an explosives area.

109 Cartons containing fireworks should be stacked so that stacks are stable and packaging will not become crushed or otherwise damaged by the height of the stack. Suppliers should be able to advise on the maximum height of stack for each type of product.

110 Where fireworks are kept outside their transport packaging (ie in a display cabinet), the fireworks should be laid out in an orderly fashion so that they will not be knocked, dropped, crushed or otherwise damaged when other items are added to or removed from the cabinet.

111 When fireworks are moved (including when they are moved in their transit packaging), they should be lifted and carefully placed. They should not be dropped, slid or dragged.

Pressure

Sources of pressure are identified and kept to the minimum necessary for the safe operation of an explosives area.

112 In most circumstances, the preventative measures used to protect fireworks from impact and friction will protect them from the effects of excessive pressure.

Chemical incompatibility

Chemicals and materials incompatible with the explosives, used or with each other, are identified, and either kept to the minimum necessary for the safe operation of the explosives facility, or completely segregated from the explosives.

113 As well as presenting a risk from fire, certain chemicals may be chemically incompatible with fireworks or present an additional explosion hazard. These chemicals should therefore be stored far enough away from fireworks so that there is no risk of contamination, and so that they cannot aggravate a fire or explosion.

114 Examples of products that could be incompatible with fireworks include:

- products containing corrosive or caustic substances (acids or alkalis) such as drain cleaners and paint strippers;
- products including certain wood preservatives which might have chemical incompatibility;
- products such as fertilisers containing oxidising agents;
- products containing peroxides such as certain fibreglass hardeners; and
- aerosols and bottled gas canisters.

Maintenance systems

The safety measures are properly maintained.

115 Maintenance systems should include:

- Identification of the safety measures and any safety-critical systems (including procedures and management arrangements), plant and equipment;
- record keeping;
- planning and prioritisation of maintenance work;
- either planned preventative maintenance or risk-based inspection and maintenance;
- inspection of the safety measures by a competent person at regular specified intervals; and
- reporting and acting on faults with systems, plant, equipment and relevant site infrastructure.

116 The maintenance regime should include periodic inspections of the safety measures to ensure that they are in place and remain effective.

117 Maintenance activities often introduce sources of ignition into firework storage areas, so should generally be subject to a high level of control, for example through a 'permit-to-work' system.

118 Further information on developing a maintenance regime and on controlling maintenance activities can be found in L150 under 'Protecting explosives from sources of ignition'.

Measures to limit the extent of a fire or explosion

(Regulation 26(1)(b))

Appropriate steps are taken to:

- **limit the size of an explosion or fire that may occur;**
- **stop fires spreading; and**
- **limit the size of an explosive event and the area that the event affects.**

119 A fire involving fireworks is likely to spread very quickly as burning projectiles are thrown around. This means that whenever it would be reasonably practicable to do so, fireworks should be kept in a storage place that can be used exclusively for this purpose.

120 Where the fireworks are kept in a warehouse (or similar room or building) that also holds significant quantities of other combustible materials, the storage arrangements will need to be designed to prevent the spread of fire by fragment throw. This will involve either:

- storing the fireworks in an ISO transport container (or similar fully enclosed metal structure);
- keeping the fireworks in storage cupboards or cabinets;
- building a structural partition to segregate the fireworks from other combustible materials; or
- keeping fireworks behind a suitably robust and suitably sized wire mesh screen or in a suitable cage.

121 Any container or enclosure should be:

- suitably constructed – it should be sufficiently robust to remain stable and effective throughout its expected working life, taking into account the expected working conditions; and
- suitably located – it must be located well away from flammable or hazardous substances. For example, in the warehouse of a DIY superstore, it should be located in the area of the warehouse used to store inert, non-combustible building materials or non-hazardous gardening products (for example, sand and cement or compost).

Protecting people from the effects of fire or explosion

(Regulation 26(1)(c))

Measures are in place to protect people in the event of a fire or explosion.

122 When fireworks are kept in places where members of the public are present, there is an increased likelihood that an accident could take place and, if there were an accident, a larger number of people could be at risk.

123 These risks need to be controlled by storing and displaying the articles in a way that limits the risks of an accidental ignition and by taking precautions to protect people (both members of the public and employees) in the event of a fire. Appendix 3 contains further information on the precautions to be taken when fireworks are displayed in the sales area.

124 The explosive content in items such as party poppers, Christmas crackers and other fireworks categorised as Category 1 under the requirements of the Pyrotechnic Articles (Safety) Regulations 2010 and toy caps subject to the Toys (Safety) Regulations 2011, present a limited risk in the quantities in which they are normally likely to be found on retail premises. These articles may be kept on open display in their retail packaging, providing that the total quantity of fireworks on display does not exceed 5 kg net mass and appropriate arrangements are in place to ensure their security.

125 Although the quantity of explosive in each item is small, large or very large quantities together may contain a significant quantity of explosive and should be treated with the same care as other explosive articles.

Limiting the numbers of people in explosives areas

The number of people in explosives areas is kept to the minimum needed to safely carry out and support the explosives operations.

126 Ensure that the number of people present in an area where fireworks are being stored is controlled, and that fireworks storage is segregated from non-explosives operations. Depending on the site, controls might include:

- physical controls that only allow authorised people access to firework stores;
- providing instructions to people engaged in the sale of fireworks;
- supervising people engaged in the sale of fireworks;
- placing signs and notices on doors or at other appropriate places indicating who is authorised to be present and the maximum number of people permitted in the area at any one time; and
- ceasing operations when visitors or unauthorised people are present in storage areas.

Engineering controls

Engineering controls to protect people from the effects of a fire or explosion are identified on a case-by-case basis.

127 If HT3 or more than 75 kg net of Hazard Type 4 fireworks are kept in a store within, or adjoining, a building containing domestic/sleeping accommodation, suitable steps must be taken to protect residents of those premises in the event of a fire. The following specific precautions must be taken:

- a fire detection system should be installed in the shop with either a linked alarm installed in the domestic accommodation or an effective sprinkler fitted in the fireworks store; the domestic parts of the building must have access/exit routes that are fire-separated from those used for the pyrotechnic store;
- there must be suitable fire separation between the pyrotechnic store and the domestic accommodation (for example, doors, floors and ceilings offering 30 minutes' fire resistance); and

- the store must be closed off and secured from the domestic part of the property in order to both prevent unauthorised access (including by children connected with the domestic accommodation) and also to help prevent the accidental introduction of sources of ignition.

128 Where these precautions cannot be taken, the licensing authority may decide that the premises are not a suitable place for the storage of explosives, and either refuse a licence or place conditions on the licence, limiting the maximum quantity of fireworks that can be stored.

Provision of personal protective equipment

Personal protective equipment is used as a last line of protection. It is not solely relied upon when people can be protected by engineering controls.

129 Personal protective equipment can protect individuals by supplementing engineering controls, or by supplementing procedural controls where engineering controls are not reasonably practicable. Further information on the regulatory framework surrounding the selection and use of personal protective equipment can be found in Personal protective equipment at work. *Personal Protective Equipment at Work Regulations 1992 (as amended). Guidance on Regulations L25* ⁶.

130 Personal protective equipment is not normally required to protect people selling fireworks from explosives hazards.

Emergency procedures

Effective emergency procedures are in place.

131 Emergency procedures must clearly set out what dutyholders, employees and others should do and should not do in an emergency. The procedures should normally be written down to allow them to be communicated to others consistently. Information on the procedures must be provided to all employees and to others involved in the site's activities. This does not necessarily require extensive documentation. For example, where a site has a single small store, the emergency procedures might consist of evacuating the area around the store and calling the fire and rescue service. In this case, the documentation might simply involve a written notice displayed prominently where all staff will see it.

132 Emergency procedures should cover:

- what constitutes an emergency;
- what to do in the event of an emergency;
- fire precautions relevant to the emergency procedures;
- fire detection and warning systems;
- means of escape and evacuation;
- providing information to the emergency services;
- what to do when the emergency is over; and
- how the recovery phase will be managed.

133 Fireworks should not be kept anywhere where, in the event of a fire, they might endanger the safety of those using escape routes from the building.

134 Further information on emergency procedures can be found in L150, under 'Protecting people from the effects of fire or explosion' and Appendix 4.

Separation distances

(Regulations 27 and 13(6))

Separation distances are met.

Application

135 A separation distance of greater than 0m will not need to be maintained to protected places that are off-site, where a site stores up to 25 kg of HT3 fireworks or 250 kg of HT4 fireworks.

136 If you want to store more than 25 kg of HT3 or 250 kg of HT4 fireworks, you should speak to your licensing authority about your intentions, and they will be able to determine what separation distances will apply to protected places on-site and off-site.

137 If you store a mixture of hazard types, the limit for the most energetic explosive will apply. For example, if HT3 fireworks are kept with HT4, then HT3 distances will apply. The quantity will be determined by adding the net mass of the HT3 explosives to the net mass of the HT4 explosives. This process is called aggregation. For example:

- 10 kg of HT3 and 200 kg of HT4 is treated as 210 kg of HT3;
- 1 kg of HT3 and 10 kg of HT4 is treated as 11 kg of HT3;
- 0.1 kg of HT1 and 250 kg of HT4 is treated as 250.1 kg of HT1.

138 If you store more than 25 kg of a mixture of HT3 and HT4 fireworks, you will need to maintain a separation distance greater than 0 m.

139 If you store more than 0.1 kg of HT1 or HT2 fireworks either with or without any other explosives including fireworks, you will need to maintain a separation distance greater than 0 m.

140 Further information on the application of separation distances can be found in L150, under 'Separation distances' and Appendix 5.

Discarding, disposal and decontamination

(Regulation 28)

Explosives and explosives-contaminated items are disposed of or discarded safely.

Explosives-contaminated items are safely decontaminated.

Discarding and disposal of explosives

Explosives are not discarded as general or household waste.

141 The discard, disposal and destruction of explosives including fireworks can be a high-hazard activity. A failure to dispose of, or discard, explosives safely is one of the main causes of events and injuries in explosives work. Explosives events can happen because of:

- a failure to recognise that explosives requiring disposal are accumulating in manufacturing, process or storage areas;
- casual attitudes when dealing with the discard or disposal of explosives, often arising out of a lack of competence or a failure to properly supervise, inspect or audit the activity;
- people not appreciating the properties and behaviour of explosives under certain conditions (explosives which have been discarded or require disposal may be unusually sensitive); and
- ill-considered systems of work or no basic safety precautions, often arising out of a failure to identify and evaluate the hazards or a failure to follow prescribed procedures.

142 Your supplier should be able to provide you with advice on how to identify and safely manage any fireworks that require disposal.

Vacating an explosives site

Vacated explosives sites are left in a safe state.

143 Where a site which has been used for the storage and retail sale of fireworks is to be vacated, it will generally be sufficient for the dutyholder to remove all the fireworks from the site and then sweep out and wash down storage areas and cabinets with water.

Prohibitions concerning manufacture, storage and importation of certain explosives

(Regulation 29)

Only approved pyrotechnics substances and articles containing sulphur and/or phosphorus mixed with chlorates are manufactured, stored and imported.

144 Pyrotechnic mixtures of sulphur and/or phosphorus with chlorates are not only liable to spontaneous ignition, but also tend to become exceedingly sensitive to ignition by friction or impact over time.

145 Anyone wishing to manufacture, import or store any pyrotechnic article or pyrotechnic substance containing these mixtures must apply to HSE for the article or substance to be approved.

146 Firework suppliers will be able to tell you whether or not a firework contains any mixtures of sulphur and/or phosphorus with chlorates, and whether or not the firework has been approved by HSE.

Prohibitions concerning the acquisition and supply of fireworks

(Regulation 9)

Large quantities of fireworks are only acquired by and supplied to people with a licence to store them.

147 Regulation 9 prohibits anyone without a licence from acquiring more than 50 kg net mass of fireworks in a single transaction. It also prohibits the sale or transfer of more than 50 kg net mass of fireworks in a single transaction unless the person to whom the fireworks are being sold or transferred shows a valid licence.

148 Carriers who transport fireworks do not need to have a licence. However, the person selling or transferring the fireworks must have been shown a valid licence for the person receiving the delivery. This will involve the recipient showing or sending the supplier a copy of the licence in advance of the delivery.

149 It is not necessary for a supplier who has already seen a copy of a licence to see a further copy for deliveries made within the period that the licence is valid.

150 In order to demonstrate compliance with this duty, anyone selling or transferring more than 50 kg net mass of fireworks in a single transaction should keep a record of whom they have sold or transferred the fireworks to (including the reference number of the licence), or alternatively keep a copy of their licence.

Security and preventing unauthorised access to fireworks

(Regulation 30)

People who manufacture, keep or store explosives ensure that those explosives are secure. Unauthorised access is prevented.

151 Entry to the room or store used for storage of the fireworks should be restricted to those members of staff who need to be there.

152 Stores should be kept locked unless access is required to the fireworks they contain.

153 Where a store is a room in a building which is used for multiple purposes and the entrance to the store cannot be secured by a locked door, the fireworks should be kept in locked storage cabinets or cages, and controls should be in place to identify and deter casual/opportunistic theft.

154 When a building used for multiple purposes is left unattended, access to the building or the fireworks should be secured by a multi-lever mortice deadlock. New or replacement locks should have at least five levers.

155 Where the entrance to a store is secured by a padlock, the padlock should be of the heavy-duty, close shackle type and the lock mechanism should have at least five levers. The hasp of the padlock should be covered by a metal shroud that will protect the hasp from attack, and the shroud should be firmly fixed to the door. When the store is located in a building that has either:

- staff present all the time; or
- external doors that are secured by multi-lever mortice deadlocks

any padlock will not need to be covered by a metal shroud.

156 Display cabinets should be lockable or should be secured by a padlock that is sufficiently robust to deter a casual/opportunistic theft when they are left unattended.

157 Fireworks that are not kept in a store or in a locked display cabinet should be subject to continuous supervision.

158 Where a site is located in a high crime area, has been targeted by intruders or repeatedly been subjected to theft, higher standards of security should be applied. For example:

- hinge bolts should be fitted to the hinges of ISO containers;
- visible alarming systems should be fitted as a deterrent; and
- the security standards applicable to relevant explosives should be considered and applied appropriately.

159 Further information on the security of explosives in general and the standards to be applied to relevant explosives can be found in L151 *Guidance on Regulations – Security provisions*³.

Appendix 1 Identifying hazard type and net mass of explosives from labelling and documentation

Identifying hazard division and indicative hazard type from transport carton labels

1 The cartons used as transport packaging for fireworks will be labelled with an orange diamond similar to those shown in figure 1. The orange diamonds identify the hazard division (HD) that the fireworks have been classified in for transport. The hazard division can then be used to determine the indicative hazard type (HT) for storage.


Figure 1 - transport classification labels



Identifying net mass from transport carton labelling

2 Firework industry voluntary good practice on labelling means cartons used as transport packaging for fireworks will also generally be labelled with the number of pieces the carton contains and the net mass of the explosives within the fireworks. Where this information is not provided on the carton, it may be found on the transport documentation or obtained directly from the supplier.

Figure 2 – transport carton labelling

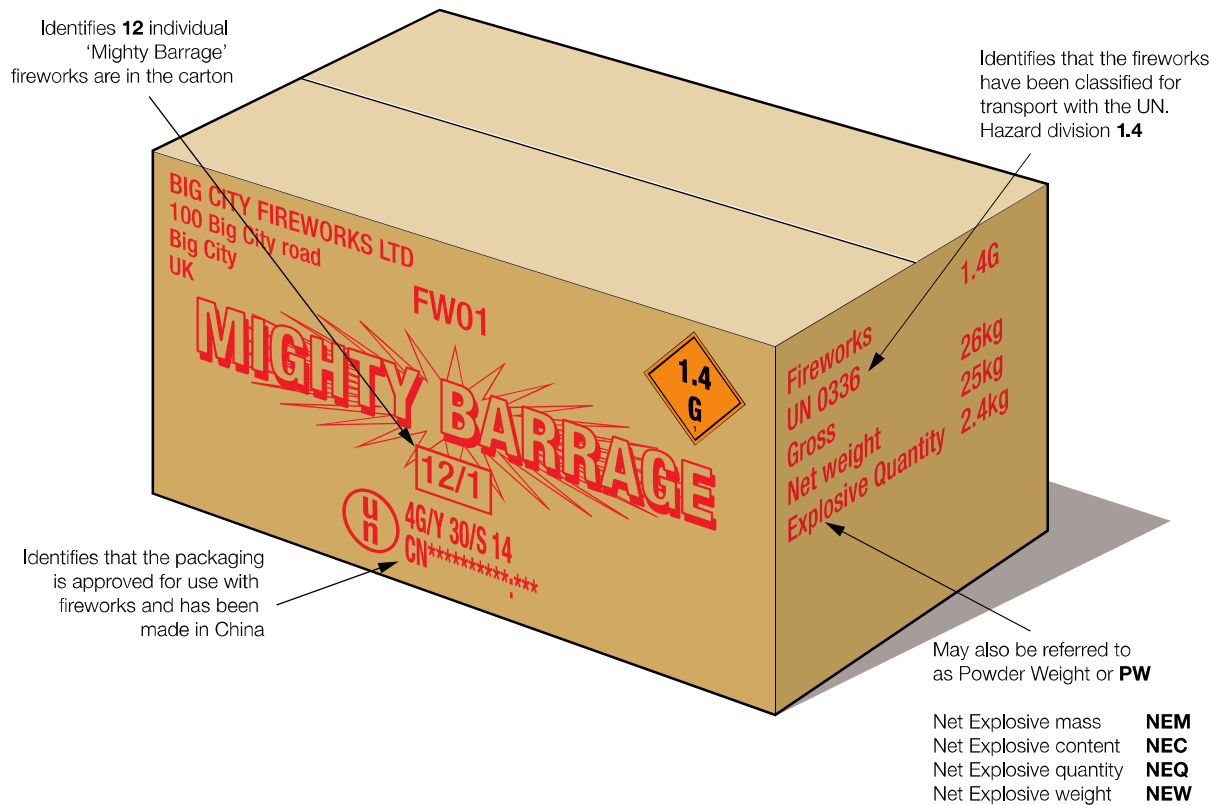

3 In the example shown in figure 2, the carton contains 12 articles with the part number 'FW01' and called 'Mighty Barrage'. The net mass of explosives in the transport carton is 2.4 kg. This means that the net mass of explosives in each 'Mighty Barrage' firework is 0.2 kg, ie:

- $2.4 \text{ kg} \div 12 = 0.2 \text{ kg}$

Identifying hazard division, net mass and classification status from transport documentation

4 When fireworks are transported in quantities of more than 50 kg net mass, they will be accompanied by transport documentation. The transport documentation identifies:

- the total quantity of explosives in the shipment;
- the hazard division of each different type of firework; and
- the competent authority of a contracting party to ADR that has classified the fireworks for transport.

Figure 3 – Dangerous goods transport document

DANGEROUS GOODS TRANSPORT DOCUMENT

CONSIGNOR		CONSIGNEE	
Company	Big City Fireworks Limited	Name	Small Town Newsagents Ltd
Address	1 Big Road Big City United Kingdom	Address	2 Small Road Small Town United Kingdom
Post Code	X12 3YY	Post Code	Z4 5AA
Contact	01234 567890	Contact	09876 543210

UN Number	Proper Shipping Name	Classification Code	Tunnel Code	Net mass of explosive contents (kg)	Number and description of packages
UN 0335	FIREWORKS	1.3G	(C5000D)	N/A	N/A
UN 0336	FIREWORKS	1.4G	(E)	250	75 boxes (4G)

Total net mass of explosive contents	250 kg
---	---------------

Über Sparklers - Classification of fireworks by the competent authority of D with the firework reference D/BAM 1234

Sky Glitter - Classification of fireworks by the competent authority of GB with the firework reference GB/HSE123456

Carriage agreed under the terms of ADR paragraph 1.5.1 (M279)

I hereby declare that the contents of this consignment are fully and accurately described above by the proper shipping name, and are classified, packaged, marked and labelled and are in all respects in proper condition for transport according to the applicable international and national government regulations.

Name	Signed	Date
A. N. Other	<i>A. N. Other</i>	1/10/2014

5 In the example shown in figure 3, the shipment contains 250 kg of explosives, and all of the fireworks have been assigned to the hazard division (HD) 1.4. The 'Über Sparklers' have been classified for transport by the German competent authority, BAM, and the 'Sky Glitter' selection boxes have been classified for transport by the United Kingdom's competent authority, HSE.

6 Where fireworks are supplied in quantities of less than 50 kg net mass, your supplier should be able to tell you the net mass of explosives within the fireworks.

Appendix 2 Further information on the suitability of cages, cabinets and cupboards for the storage of fireworks

Introduction

1 This appendix provides information on the findings of tests carried out by the Health and Safety Laboratory (HSL) on the effects of a fire involving consumer fireworks stored in roller cages, metal and wooden cupboards. It also provides guidance to retailers and advice to enforcing authorities to assist them in taking these results into account when considering what storage arrangements are appropriate for fireworks on retail premises or in stockrooms and warehouses.

The tests

2 Four sets of tests were carried out. These involved:

- fireworks stored in roller cages using a 50 mm mesh (3 mm gauge). These were chosen as the standard roller cage typically found in supermarkets. It is important to note that the clasp fitting (allowing the unit to be locked or sealed with tamper-proof tags) and hinges were all constructed of metal (rather than plastic);
- fireworks stored in a roller cage where the 50 mm mesh had been removed and replaced with 25 mm mesh (3 mm gauge);
- wooden cupboards. These were purchased from a national chain of office equipment shops and constructed of 19 mm chipboard, melamine-coated (all surfaces, including the back);
- metal cupboards. Again these were purchased from a national chain of office equipment suppliers and were constructed of 2 mm thick steel panels pop-riveted/welded at 30 mm intervals.

3 The tests involved lighting a fire next to the cage/cupboard and then recording the effects, ie the tests were designed to assess the effects of a fire, and not the likelihood of a fire occurring. In premises where there is an effective fire detection and alarm system, the premises would have been evacuated before the fireworks caught fire. An effective fire suppression system would extinguish the fire before it spread to the fireworks.

4 The fireworks were seven transport packs of selection boxes supplemented by five packs of rockets. The results were as follows:

- 50 mm mesh cages: there was significant fragment throw and ejection of projected effects, including complete rockets, over a wide area;
- 25 mm mesh cages: the 25 mm mesh cages largely prevented large fragments and projected effects from being ejected. There was some fragment throw and projected effects including stars over a more limited area;
- the wooden cupboard offered significant (15-minute) fire resistance. However, it did eventually catch fire and collapsed. Once it had burnt away and the fire had spread to the fireworks, it did little to contain fragment throw or projected effects;
- the metal cupboard offered much less fire resistance (less than a minute) than the wooden cupboard, but it retained its structural integrity and was successful in very largely preventing fragment throw or the escape of projected effects. However, the cupboard became extremely hot and the contents continued to smoulder for some 20 hours.

Guidance

5 The tests reflect a scenario where a fire has already become established. In such situations, the priority is to ensure that there is sufficient time for people to escape, and that a fire involving the fireworks does not threaten escape routes and people trying to escape. Fireworks, if uncontained, can significantly increase the speed at which a fire can spread; suitable storage arrangements can prevent or slow the spread of a fire.

6 The following paragraphs apply to the use of cages for the longer-term storage of fireworks rather than the use of cages to move the fireworks or to provide short-term interim storage.

50 mm mesh cages

7 Where fireworks are stored in 50 mm mesh roller cages, additional physical and management measures will be required in order to:

- detect fire before it spreads to the fireworks;
- prevent or slow down the spread of fire to the fireworks;
- prevent or slow down the spread of fire from the fireworks, so that people can be safely evacuated.

8 This combination of measures could take the form of storing the fireworks either exclusively in a room, or enclosure, separated from the rest of the premises by a fire-resisting partition, or the provision of an effective automatic fire detection and suppression system. The use of cages would be appropriate where either of these conditions is met.

9 The use of these cages may also be appropriate where there is a fire detection system but no suppression system. In such a case, additional physical and/or management measures will need to be taken to reduce the likelihood of a fire communicating to the fireworks, and vice versa:

- the fireworks must only be stored adjacent to articles or materials that are incombustible or that would not readily catch fire (this would include a wall or walls);
- alternatively, empty space greater than the maximum distance that any fragment could be thrown or effect projected should be left between the fireworks and other combustible items.

10 Where there is no fire detection system, 50 mm cages should not be regarded as an appropriate measure for preventing the spread of fire by fragment throw or projected effects.

11 50 mm cages will generally be appropriate for the storage of fireworks complying with Category 1 according to the Pyrotechnic Articles (Safety) Regulations 2010 where the fireworks:

- have been segregated from combustible materials, including other fireworks; and
- a fire alarm system has been installed.

25 mm mesh cages

12 The test results indicate that 25 mm mesh cages give a higher level of protection against fragment throw or projected effects.

13 25 mm cages will not contain burning stars or small pyrotechnic units. Although burning stars have a limited life, there is still a risk of fire spread. It will therefore still be important to take additional measures, such as not storing in proximity to readily combustible materials, and storing adjacent to incombustible materials, in order to further reduce fire risk.

14 These cages should not be used where there is no fire detection system or fire alarm system.

Points applying to all mesh cages

15 Whichever type of cage is used, the following measures should be taken:

- the cage should fully enclose the contents, ie it should have an integral top of the same mesh gauge;
- the cage should be in good condition with no breaches in the integrity of the mesh;
- any plastic hinges and securing mechanisms should be properly reinforced with wire to prevent the premature failure of the gate;
- the fireworks should be kept in their closed transport cartons;
- the cage gate should be kept securely closed except when the fireworks are being handled; and
- the top of the cage should not be used to store other commodities or used packaging materials etc.

16 Where cages are used in an area where other goods are stored, the fireworks should be kept under regular supervision and limited in quantity – the maximum number of cages should be appropriate to the available storage area and the nature and quantity of the other goods stored in that area.

17 Where there is no fire detection system or fire alarm system, or if there is only one escape route from the premises, wooden or metal cupboards (in sound condition) can be used in a stockroom or warehouse instead of mesh cages, provided that they are suitably segregated from combustible materials.

Relevant assumptions and type testing

18 The fireworks used in the HSL tests were low-power fireworks (ie Category 2 and 3 or UN Hazard Division 1.4). If more powerful fireworks (especially those containing flash powder compositions) are to be stored, there is a potentially significant hazard from the rapid build-up of gases in the cupboard leading to either:

- the opening on the cupboard's doors which would allow fragment and projected effects to escape the cupboard; or
- the violent rupture of the cupboard and flying metal shrapnel or wooden splinters.

19 Storage arrangements for such fireworks, which would generally fall into Category 4 or attract a classification under the provisions of the UN default table of Hazard Division 1.3, 1.2 or 1.1, should be subject to relevant tests in order to demonstrate the effectiveness of any cage or cupboard. The firework importer should be able to provide further information about the composition used in particular types of firework and the results of any type testing conducted.

20 Where a cage or cupboard differs in specification from those described above, its appropriateness for use and its effectiveness should be confirmed by relevant testing.

Appendix 3 Further information on the display of fireworks in a sales area

Introduction

1 Additional appropriate measures to those normally used for the storage of fireworks and other explosives should be taken when fireworks are placed on display in a sales area. These additional measures are necessary to control the increased risks that an explosive event could take place and to ensure that members of the public present on the premises are protected.

2 Whenever reasonably practicable to do so, the risks from fireworks should be eliminated by using labelled inert or non-explosive samples of fireworks for displays. Live articles and dummies should not be mixed, and only HT4 fireworks should be kept on display in the sales area.

3 Fireworks that have been removed from mitigatory packaging should not be put on display in the sales area.

Preventing accidental ignition

4 Fireworks on the shop floor should be kept:

- in a designated area well away from sources of ignition (for example naked flames, lit cigarettes and portable gas heaters); and
- on display in a display case or in a display case's small integral store.

5 In this context, 'well away' means far enough to remove the risk of ignition. This distance will depend on the nature of the source of ignition and whether there are any barriers between the articles and the potential source of ignition.

6 Smoking should not be allowed anywhere where pyrotechnic articles are stored or sold. 'No smoking' notices should be displayed and appropriate action should be taken when someone is found smoking.

7 Display cases and storage cabinets should be designed to protect against sparks or other sources of ignition expected in the environment where they are being used. They should also be designed to prevent handling of unpackaged items by members of the public or staff who are not specifically engaged in activities related to the sale of the fireworks.

8 When live samples are removed from a display case, they must be kept under the supervision of a member of staff until sold.

9 Display cases should not be used for the display or storage of other articles (except any instruction leaflets/safety literature) so that the case is only opened when the fireworks are sold. Fireworks should not be kept in the same display case as flammable substances, chemicals or other pyrotechnic articles.

10 Lights or other electrical fittings should only be used in display cases containing dummy fireworks. If such cabinets are to be used to store or display live articles, they must be disconnected from the electrical supply and measures taken (such as warning notices) to prevent the apparatus from being inadvertently reconnected.

11 Appropriate steps must be taken to prevent unauthorised access to display cases. Normally, this would mean using lockable or padlocked cases that are locked when unattended.

Controlling the quantity in the sales area

12 The levels of stock held in the sales area should be controlled. Controlling levels of stock will limit the extent of the hazard to which people would be exposed in the event of a fire by avoiding storing unnecessary quantities of explosive on the shop floor. However, in considering how much stock to keep in the sales area, it will also be necessary to avoid excessive transport movements through the shop, taking into account the anticipated trading levels for the day.

13 The amount kept on the shop floor should not exceed the levels set out in Table 1 unless the licensing authority has specified a greater maximum quantity. Where significant quantities of highly flammable liquids or other highly flammable articles are likely to be present in the sales area, the amount to be stored will need to be reduced to take into account the additional fire loading from these substances. This decision should be made by a competent person and will depend on factors such as whether the premises have an automated sprinkler system etc. It is also important to remember that the licence quantity limit applies to the amount held on the premises, including the amount held on the shop floor.

14 Regulation 13(7) provides for the licensing authority to insert additional licence conditions where fireworks are offered for sale at a site. These licence conditions may cover:

- the amount of fireworks that can be kept in the area to which the public has access;
- the location of the sales/storage areas in relation to escape routes and the storage of flammable substances (if any);
- escape routes;
- fire safety measures such as the provision of smoke detectors or restrictions on the presence of flammable substances; and
- other safety precautions.

15 The licensing authority may therefore issue a licence to permit a greater amount to be kept than that specified in the table or may specify a reduced quantity in the conditions of the licence. Where the licensing authority is not the fire and rescue service, they may need to consult a competent person in order to make an assessment of any appropriate conditions that should be attached to any licence.

16 The table takes into account the size of the sales area where the fireworks are present and from which the public will need to escape. Where the premises are divided into a number of sales areas (whether rooms or otherwise enclosed areas), the size of the individual room or area where the pyrotechnics are sold should be used in determining the maximum amount of fireworks that may be kept in the sales area (as distinct from the maximum amount that may be kept on the site).

Table 1 Maximum quantities on the shop floor

Total floor area of the sales area (square metres)	Maximum quantity of fireworks that may be kept under a licence requiring a separation distance of 0 m (net mass – kg)	Maximum quantity of fireworks that may be kept under a licence requiring a separation distance of greater than 0 m (net mass – kg)
up to 20	12.5	20
up to 40	15	25
up to 60	20	35
up to 80	25	50
up to 100	30	60
up to 150	35	70
up to 200	40	80
up to 250	45	90
up to 300	50	100
up to 350	55	110
up to 400	60	120
up to 450	65	130
up to 500	70	140
500 and over	75	150

17 The amount that can be kept in any given location will depend on the circumstances, and on the need to comply with the requirements of the Regulations. For example, in considering where to locate the display/storage area, it is essential to ensure that the items are located so that employees and members of the public can easily evacuate the area in the event of a fire.

18 The responsibility for controlling the amount of fireworks on the premises also extends to designing sales systems that avoid the need for customers to carry quantities of fireworks (other than party poppers and other similar novelties) around the shop and enable/encourage customers to make (or collect) their purchases immediately before leaving the shop. This should be achieved by operating a system where customers can order their purchases and pick them up on their way out, or by selling fireworks from a separate sale point located near to, but not impeding, the exit.

Slowing the spread of fire in the sales area

19 As well as controlling the overall total of fireworks kept on the shop floor, the hazard should be reduced by taking steps to slow the spread of fire both within the stock and from the fireworks to other flammable substances.

20 In order to slow the spread of fire, the fireworks should be divided between storage cabinets, or display cases, each holding no more than 12.5 kg net mass of fireworks.

21 The storage cabinets and display cases should be constructed from materials that do not readily catch fire.

Protecting people in the sales area in the event of a fire

22 The safety measures to be taken to protect people in the event of a fire are:

- ensuring that they are able to escape quickly from the area and from the shop;
- controlling the quantity of fireworks present on the shop floor;
- breaking that quantity down into smaller units (so that if there is a fire, this does not immediately involve the whole stock) and taking steps to slow the spread of fire between the units; and
- taking steps to ensure that, if the fireworks catch fire, the fire does not easily spread to other flammable substances on the shop floor.

23 The provision of fire escapes and other precautions is covered by fire safety legislation. Anyone storing and selling fireworks must ensure that they comply with the relevant requirements of that legislation, and in particular ensure that the fireworks are not stored or placed anywhere where they would endanger people escaping from a fire, or impede their exit routes.

24 Further information on how to plan for an emergency on an explosives site can be found in Appendix 4 of L150. It is particularly applicable to those sites which are complex or where higher-hazard or higher-risk explosives operations take place.

Glossary

competent authority an authority or other body designated as such in member states which are contracting parties to the European Agreement Concerning the International Carriage of Dangerous Goods by Road (ADR). A list of competent authorities can be found on the United Nations website www.unece.org.

cross-cutting safety precaution an appropriate measure that addresses more than one duty.

explosion a violent reaction of an explosives substance or article with the potential to cause harm or damage to its surroundings by either shock, overpressure, thermal effects or projected effects and fragments.

explosive includes explosive articles (including fireworks), explosive substances and desensitised explosives. Explosives are defined according to their properties and by the criteria in the United Nations Recommendations on the Transport of Dangerous Goods as revised or reissued from time to time. Pyrotechnic substances are considered to be explosives for the purposes of the Regulations, along with pyrotechnic articles that would, if classified for transport, fall within UN Class 1 or be too dangerous to transport because of their explosive properties. However, this does not mean that a substance or an article has to have been subjected to formal classification procedures before it is considered to be an explosive.

explosives area any area, which may be outdoors or within a building, where explosives are stored, manufactured, disposed of or otherwise processed.

explosives building any building in which explosives are stored, manufactured, or otherwise processed.

explosives operations any activity involving explosives which is subject to the requirements of the Regulations. It will include manufacture, storage, disposal, discard and decontamination, and may include explosives processing that does not constitute manufacture and, on certain sites, use.

fire safety legislation the Regulatory Reform (Fire Safety) Order 2005 (SI 2005/1541) and its equivalent in Scotland, the Fire (Scotland) Act 2005 (asp 5) and legislation made under it.

firework an explosive article producing a pyrotechnic effect designed for entertainment and classified for transport as UN 0333, UN 0334, UN 0335, UN 0336 and UN 0337.

flammable fines small particles of flammable materials. They are generally much easier to ignite than the bulk material because they have a much higher specific surface area. Flammable fines can be generated when packaging materials, such as wood or cardboard, are moved into or out of buildings and rub against walls, doors or equipment.

HSE the Health and Safety Executive.

initiation the act of causing an explosive material to ignite, burn, deflagrate, detonate or otherwise explode.

ISO container a steel freight container specially designed to facilitate the transport of goods, designed and constructed to a relevant standard, and used for the storage of explosives.

manufacture the interpretation in the Regulations specifies certain activities that are regarded as manufacture. However, manufacture is not limited to these activities, but would include any activity where the process undertaken changes the nature of the substance or article. This includes processes where explosive substances or explosives are made or assembled, or unmade or disassembled (for example, manufacture of gunpowder, filling or fusing of fireworks, assembling fireworks displays from components).

There are a number of processes which are not considered to be 'manufacture' for the purposes of the Regulations. These can include:

- packing or repacking explosives or explosive articles;
- breaking down explosives stored in bulk into smaller storage containers;
- labelling explosives or explosive articles;
- testing and proofing explosives or explosive articles; and
- using explosive articles as components to make a product which is not classified as an explosive (for example, the preparation of an explosive actuator into a fire drencher system, fitting air bags to vehicles, fitting ejector seats and other pyrotechnic articles to aircraft).

Where these activities alone are undertaken, there is no requirement to hold a licence under regulation 6. However, such activities fall within the scope of the Regulations as a whole, and of the safety requirements set out in regulations 26 to 29.

net mass the terms 'net explosive content' and 'net explosive quantity' are commonly used in the industry to refer to the weight of the explosive contained within an article (ie less packaging, casings etc). Although these terms are commonly understood to refer to mass, there is scope for differing interpretations of 'content' and 'quantity' in that these could be taken to refer to volume. The term 'net mass' is used for the sole reason of avoiding any scope for confusion or misinterpretation.

offshore the belt of sea over which the UK exercises sovereign jurisdiction and any area designated under:

- section 1(7) of the Continental Shelf Act 1964;
- section 1(5) of the Energy Act 2008;
- a 'renewable energy zone' designated by section 84(4) of the Energy Act 2004.

ONR the Office for Nuclear Regulation.

person the term 'person' is used in a number of the Regulations. 'Person' can be an individual and it includes a body of persons corporate or unincorporated.

place of reasonable safety in a non-explosives building, the meaning of 'place of reasonable safety' is the definition in the fire safety legislation guide⁷:

a place within a building or structure where, for a limited period of time, people will have some protection from the effects of fire and smoke. This place, usually a corridor or stairway, will normally have a minimum of 30-minutes' fire resistance and allow people to continue their escape to a place of total safety.

For buildings containing explosives, it should be either an exit from a building (including its mound, where present) or a place within the building where, for a limited period of time, people will have some protection from the effects of fire, smoke and radiated heat. This place must have suitable fire resistance to allow people to continue their escape to a place of total safety.

place of total safety in a non-explosives building, the meaning of 'place of total safety' is the definition in the fire safety legislation guide⁷:

a place, away from the premises, in which people are at no immediate danger from the effects of the fire.

For buildings containing explosives, in addition to the above, it includes a place away from the building in which people are at no immediate danger from the effects of the fire or potential explosion.

For explosives sites, the place of total safety is not the same as the 'minimum hazard zones' identified within the operational guidance for the fire and rescue service.

propagation the process of burning, deflagration, detonation or other explosive effect progressing through the mass of material in a container or stack.

pyrotechnic articles articles that contain explosives substances or an explosive mixture of substances designed to produce heat, light, sound, gas or smoke, or a combination of such effects, through self-sustained exothermic chemical reactions. They include fireworks plus other items such as flares, smoke signals and flash cartridges. Pyrotechnic articles will also include all such articles that have been characterised as such by a notified body under the provisions of Directive 2007/23/EC, pyrotechnic articles that are equipment falling within the scope of Directive 96/98/EC, and percussion caps intended specifically for toys falling within the scope of Directive 2009/48/EC. Pyrotechnic articles will also include those articles that have been identified as such by Directive 2004/57/EC.

pyrotechnic substance an explosive substance of a kind designed to produce heat, light, sound, gas or smoke, or a combination of any of these, as a result of non-detonative, self-sustaining, exothermic chemical reactions.

reasonably practicable this means balancing the level of risk against the measures needed to control the real risk in terms of money, time or trouble. However, you do not need to take action if it would be grossly disproportionate to the level of risk. See www.hse.gov.uk/risk/expert.htm.

relevant explosive an explosive for which an 'explosives certificate' is required under regulation 5 of ER2014 for acquiring or keeping that explosive, or would be required if it were not being acquired or kept by a person or organisation exempted by regulation 3(7). In relation to regulations 35 (records) and 37 (reporting loss) of ER2014, it also includes:

- ammunition, the acquisition of which is regulated or prohibited by virtue of the Firearms Act 1968 to 1997; and
- smokeless powder

even though, in the case of smokeless powder, an explosives certificate is not always required for their acquisition or keeping.

Explosives listed in Schedule 2 (other than smokeless powder as noted above) and pyrotechnic articles (apart from those listed in Schedule 3) are *not* relevant explosives.

Fireworks are *not* relevant explosives.

relevant standard a code of practice or other standard linked to legislation (CEN, BS EN, ANSI, BS, IEC, ISO) or a published and commonly known industry-produced standard of performance, providing specific standards relevant to an explosives operation, activity or facility.

A relevant standard will be a document established by consensus and approved by a recognised body that provides for common and repeated use, rules, guidelines or characteristics for activities or their results, aimed at achieving the optimum degree of order in a given context.

A relevant standard will be based on consolidated results of science, technology and experience.

site 'site' is defined as 'the whole area under the control of the same person'. In most instances, it will be the same as the area of the establishment at which the explosives operations take place, although in some cases the extent of the area under control of that person will be much greater than the area within which the explosives operations take place. See www.hse.gov.uk for more detailed guidance on the application of the Regulations to sites which are shared by different people, and between a parent company and its subsidiaries (or between subsidiaries).

storage includes all possession, keeping or holding other than when the explosives are actually undergoing manufacture or are in use.

storage area any area where explosives are stored either on a short- or long-term basis.

References and further reading

References

- 1 *Storing and selling fireworks safely: Advice for anyone selling fireworks* HSE 2014
www.hse.gov.uk/pubns/indg407.pdf
- 2 *Explosives Regulations 2014. Guidance on Regulations – Safety provisions* L150 HSE Books 2014 ISBN 978 0 7176 6551 8
- 3 *Explosives Regulations 2014. Guidance on Regulations – Security provisions* L151 HSE Books 2014 ISBN 978 0 7176 6638 6
- 4 *Fireworks in shops: Retailers' risk assessment checklist* HSE 2015
www.hse.gov.uk/pubns/indg407ch.pdf
- 5 *Fire safety risk assessment: Offices and shops* Department for Communities and Local Government 2006 www.gov.uk/government/publications/fire-safety-risk-assessment-offices-and-shops
- 6 *Personal Protective Equipment at Work (Second edition). Personal Protective Equipment at Work Regulations 1992 (as amended). Guidance on Regulations* L25 (Second Edition) HSE Books 2005 ISBN 978 0 7176 6139 8 www.hse.gov.uk/pubns/books/l25.htm
- 7 Fire safety legislation guide www.gov.uk/government/collections/fire-safety-law-and-guidance-documents-for-business

Further reading

Hazard identification and evaluation and the assessment of risk

General information on risk assessment can be found at www.hse.gov.uk/risk/index.htm

More information describing approaches to the identification and evaluation of explosives hazards and the assessment of risks associated with explosives operations can be found in:

Risk assessment for explosives including fireworks: A practical approach to risk assessment which is relevant to small companies including wholesale and retail organizations involved in the storage, distribution and supply of explosives including fireworks Confederation of British Industry 2012
www.eig.org.uk/eig2007/wp-content/uploads/Guide-on-Risk-Assessment-.pdf

Fireworks in shops: Retailers' risk assessment checklist HSE 2015
www.hse.gov.uk/pubns/indg407ch.pdf

Protective measures: A guide on measures other than personal protective equipment to protect people in explosives working areas Confederation of British Industry 2003 ISBN 0 85201 572 0
www.eig.org.uk/eig2007/wp-content/uploads/PROTECTIVE_MEASURES.pdf

Managing safety

More information on establishing effective management arrangements can be found in the following references:

See the *Health and safety made simple* website for basic information for businesses
www.hse.gov.uk/Simple-health-safety/index.htm

See the *Health and safety toolbox* website for more information on multi-occupancy workplaces
www.hse.gov.uk/toolbox/index.htm

The health and safety toolbox: How to control risks at work HSG268 HSE Books 2014 ISBN 978 0 7176 6587 7 www.hse.gov.uk/pubns/books/hsg268.htm

Managing for health and safety website www.hse.gov.uk/managing/

Managing for health and safety HSG65 (Third edition) HSE Books 2013 ISBN 978 0 7176 6456 6 www.hse.gov.uk/pubns/books/hsg65.htm

Worker involvement

See the *Worker involvement* website for more information on consulting employees www.hse.gov.uk/involvement

Leadership

Leadership is particularly important in organisations that manage major hazards such as explosives. More information on leadership in health and safety can be found at www.hse.gov.uk/leadership

Training and competence

For general advice on health and safety training, see *Health and safety training: A brief guide* Leaflet INDG345(rev1) HSE Books 2012 www.hse.gov.uk/pubns/indg345.htm

To find competence-related guidance for a specific industry, task or working environment including National Occupational Standards and Sector Skills Councils, see www.hse.gov.uk/competence/industry-specific-competence.htm

Controlling maintenance and permits to work

Further information on controlling maintenance activities and permits to work can be found at:

Isolation and permits to work www.hse.gov.uk/safemaintenance/permits.htm

Guidance on permit-to-work systems: A guide for the petroleum, chemical and allied industries HSG250 HSE Books 2005 ISBN 978 0 7176 2943 5 www.hse.gov.uk/pubns/books/hsg250.htm

Managing contractors

Using contractors: A brief guide Leaflet INDG368(rev1) HSE Books 2013 www.hse.gov.uk/pubns/indg368.htm

Managing contractors: A guide for employers HSG159 (Second edition) HSE Books 2011 ISBN 978 0 7176 6436 8 www.hse.gov.uk/pubns/books/hsg159.htm

Topic-based guidance

Further information on a wide range of explosives safety-related topics can be found at www.eig.org.uk

Further information on the control of electrical, electrostatic and electromagnetic hazards and the hazards arising out of surface temperatures of equipment can be found in:

Guidance for electrical installation and equipment within explosives manufacturing and storage facilities including fireworks Confederation of British Industry 2009 ISBN 978 0 85201 722 7 www.eig.org.uk/eig2007/wp-content/uploads/30777%20BAE%20Systems%20CBI%20GuideV2.pdf

Further information on protecting people from the effects of explosive events can be found in:

Protective measures: A guide on measures other than personal protective equipment to protect people in explosives working areas Confederation of British Industry 2003 ISBN 0 85201 572 0 www.eig.org.uk/eig2007/wp-content/uploads/PROTECTIVE_MEASURES.pdf

Fire safety

Fire safety www.hse.gov.uk/toolbox/fire.htm

Planning for emergencies

Emergency procedures www.hse.gov.uk/toolbox/managing/emergency.htm

Disposal

Further information on the safe disposal of explosives and explosives-contaminated items can be found in:

Guidance for the safe management of the disposal of explosives Confederation of British Industry 2007 www.eig.org.uk/eig2007/wp-content/uploads/disposal_guide.pdf

The safe disposal of damaged fireworks Fireworks Enforcement Liaison Group, Chief Fire Officers Association 2009 www.cfoa.org.uk/11893

Decontamination and vacating an explosives site

Management guidance for the safe decommissioning of explosives sites: A guide to the safe decommissioning of explosives sites, the relevant legislation, and the techniques used for decontamination Confederation of British Industry 2003

Pyrotechnic Articles (Safety) Regulations 2010

Further information on the Pyrotechnic Articles (Safety) Regulations 2010 can be found at www.gov.uk/government/publications/guidance-on-the-pyrotechnic-articles-safety-regulations-2010

Shipping dangerous goods including fireworks

General information on shipping dangerous goods can be found at www.gov.uk/shipping-dangerous-goods/overview

Further information on the carriage of dangerous goods by road and rail can be found at www.hse.gov.uk/cdg/

Further information on the carriage of explosives by road can be found in *Industry Code of Practice for Carriage of Explosives by Road Regulations* Confederation of British Industry www.eig.org.uk

Further information on sending dangerous goods by post can be found at www.royalmail.com/sites/default/files/DangerousGoods_BusinessCustomerBooklet_July2013_0.pdf..unpublished

Further information

For information about health and safety, visit www.hse.gov.uk/. You can view HSE guidance online and order priced publications from the website. HSE priced publications are also available from bookshops.

You can report inconsistencies or inaccuracies in this guidance by sending an email to the Explosives Legislative Review team (ELR@hse.gsi.gov.uk). Reports of inconsistencies or inaccuracies will be considered by the Explosives Industry Forum (webcommunities.hse.gov.uk/connect.ti/explosives/grouphome).

Published by HSE 05/2015